
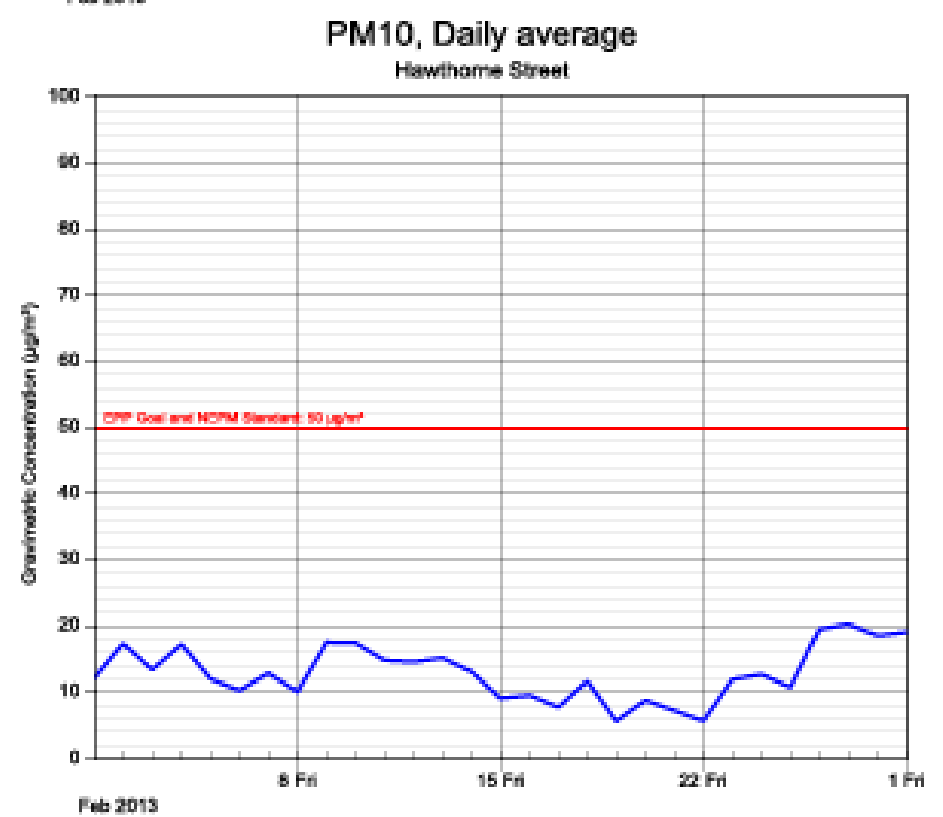
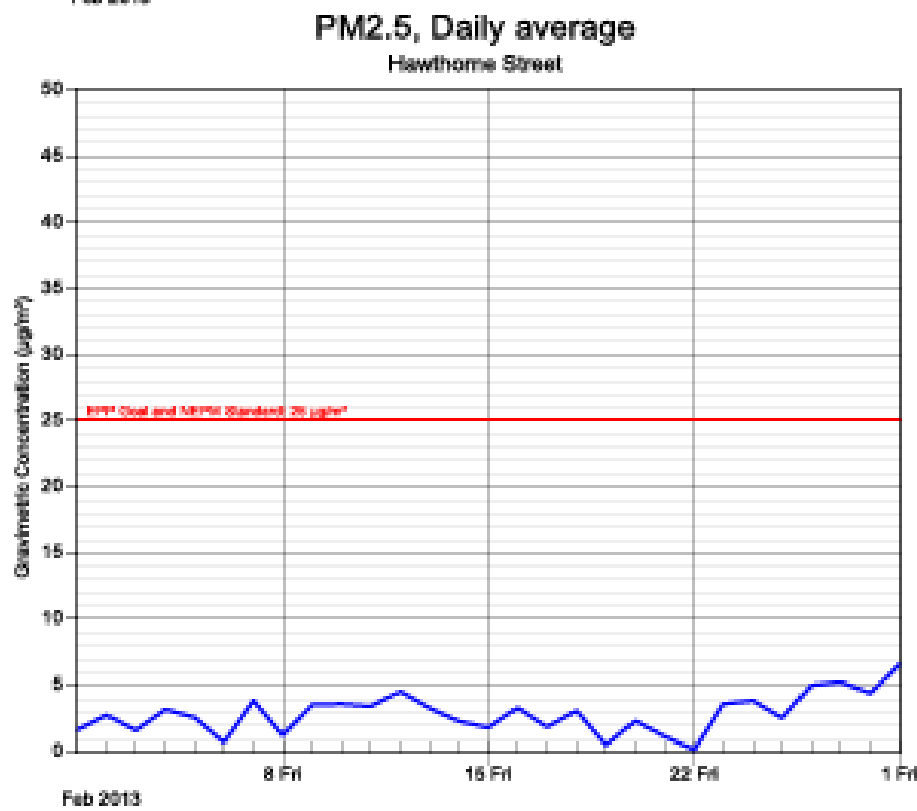
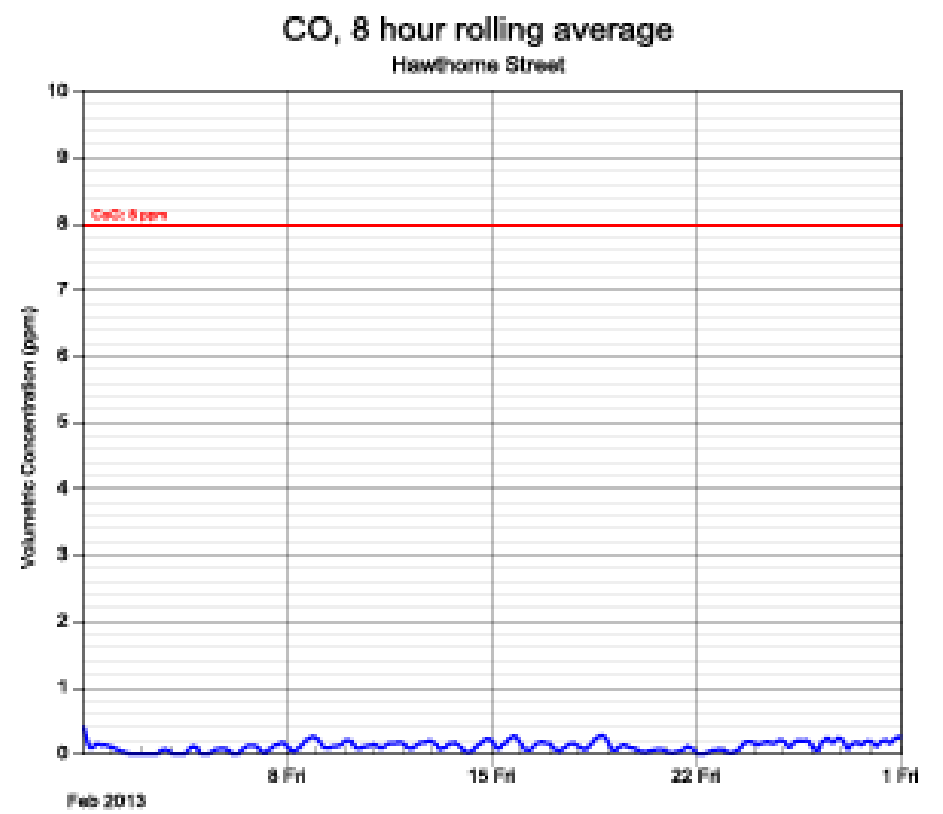


1. Hawthorne St (Southern Low Level) - Maximum Values for February 2013





| Parameter | EPP Goal | Averaging Period | Maximum Value | Wind Direction | Date & Time |
|-------------------|----------------------|------------------|----------------------|----------------|------------------|
| NO ₂ | 120 ppb | 1 hour | 19.2 ppb | 42° | 28/02/2013 22:00 |
| CO | 9 ppm | 8 hours | 0.25 ppm | 132° | 18/02/2013 08:00 |
| PM _{2.5} | 25 µg/m ³ | 24 hours | 5 µg/m ³ | 90° | 27/02/2013 |
| PM ₁₀ | 50 µg/m ³ | 24 hours | 20 µg/m ³ | 90° | 27/02/2013 |

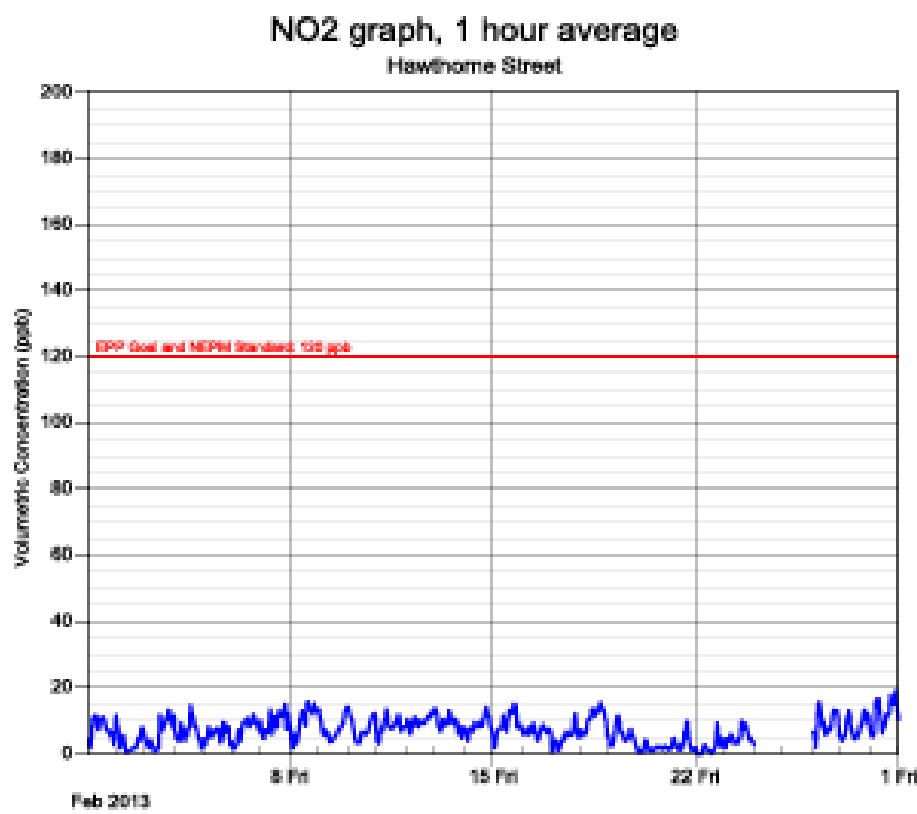

Exceedances: No exceedances for February 2013

2. Landcentre (Southern High Level) – Maximum Values for February 2013





| Parameter | EPP Goal | Averaging Period | Maximum Value | Wind Direction | Date & Time |
|-------------------|----------------------|------------------|----------------------|----------------|------------------|
| NO ₂ | 120 ppb | 1 hour | 19 ppb | 51° | 28/02/2013 22:00 |
| CO | 9 ppm | 8 hours | 0.3 ppm | 240° | 23/02/2013 08:00 |
| PM _{2.5} | 25 µg/m ³ | 24 hours | 6 µg/m ³ | 119° | 27/02/2013 |
| PM ₁₀ | 50 µg/m ³ | 24 hours | 20 µg/m ³ | 119° | 27/02/2013 |

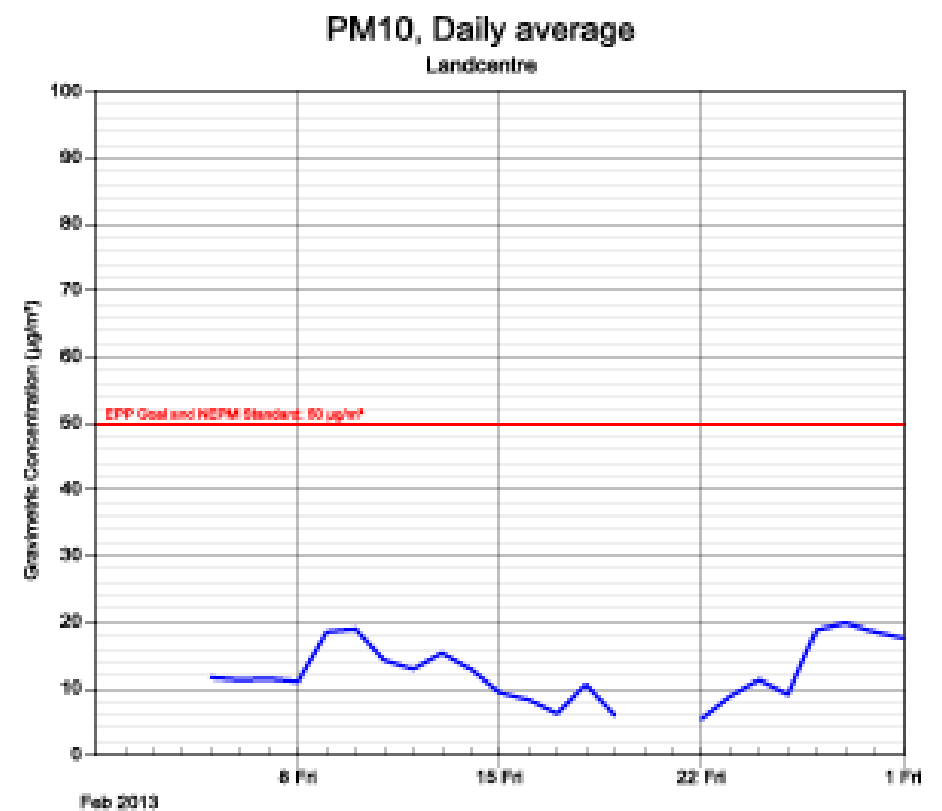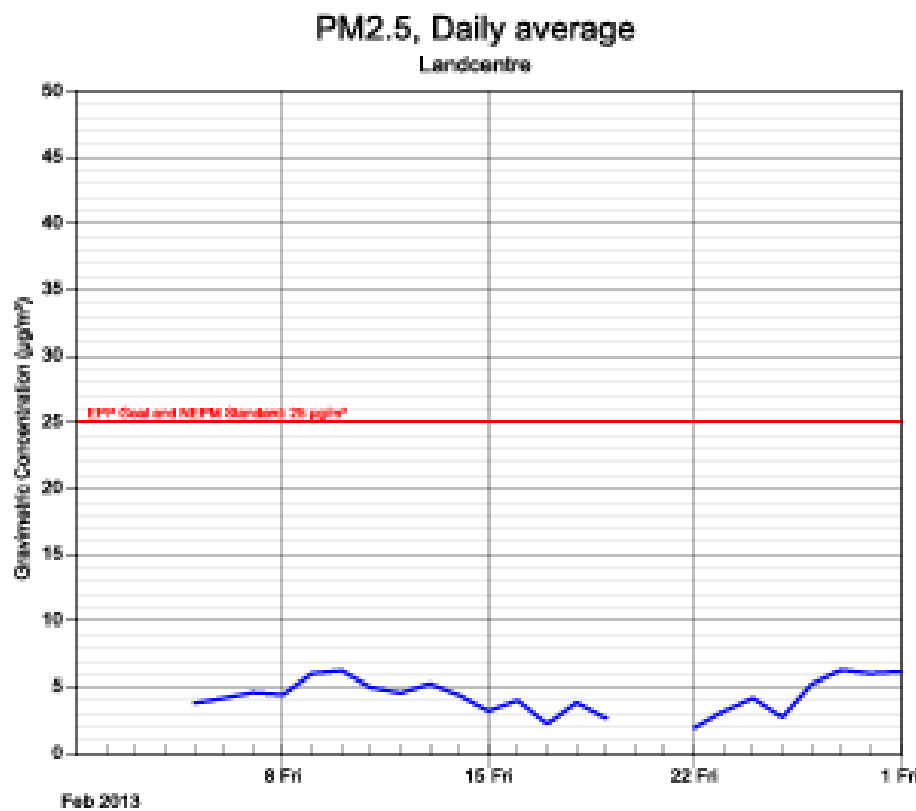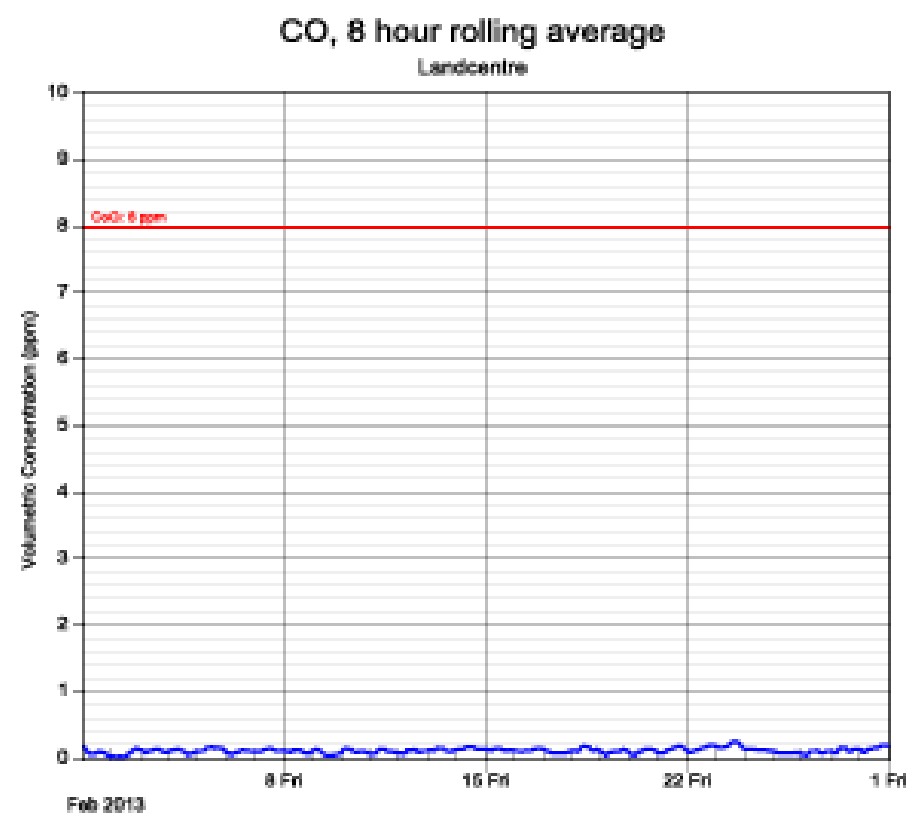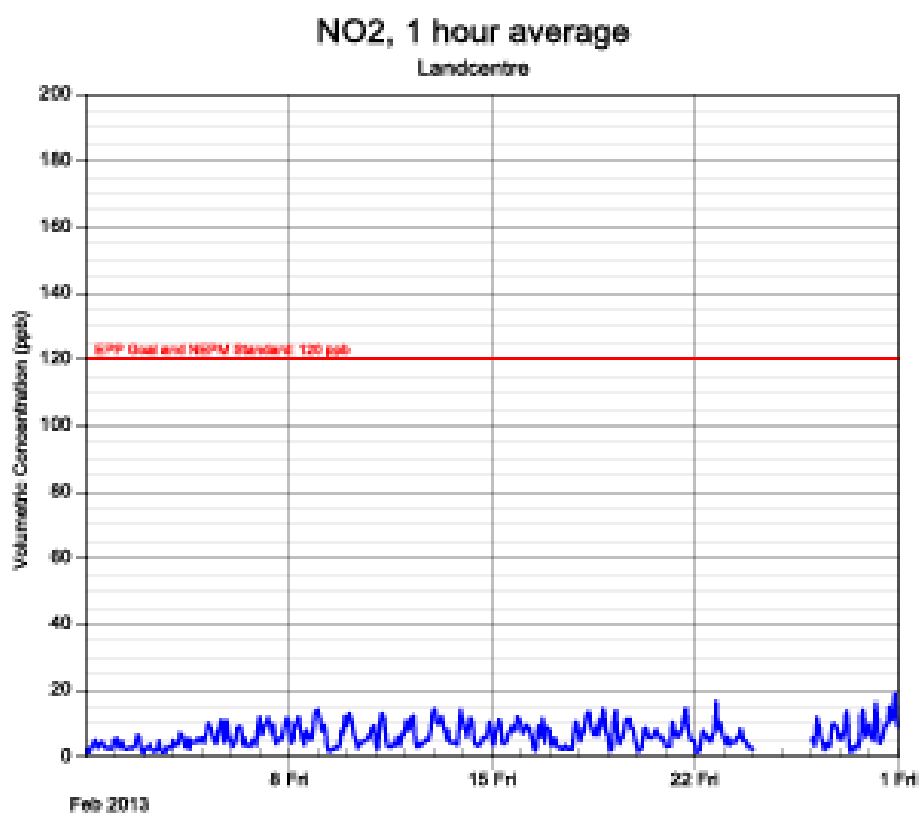

Exceedances: No exceedances for February 2013

3. Northey St (Northern Low Level)– Maximum Values for February 2013

| Parameter | EPP Goal | Averaging Period | Maximum Value | Wind Direction | Date & Time |
|-------------------|----------------------|------------------|---------------------|----------------|------------------|
| NO ₂ | 120 ppb | 1 hour | 24 ppb | 137° | 15/02/2013 16:00 |
| CO | 9 ppm | 8 hours | 0.2 ppm | Not available | 08/02/2013 16:00 |
| PM _{2.5} | 25 µg/m ³ | 24 hours | 0 µg/m ³ | N/A | N/A |
| PM ₁₀ | 50 µg/m ³ | 24 hours | 5 µg/m ³ | 79° | 27/02/2013 |

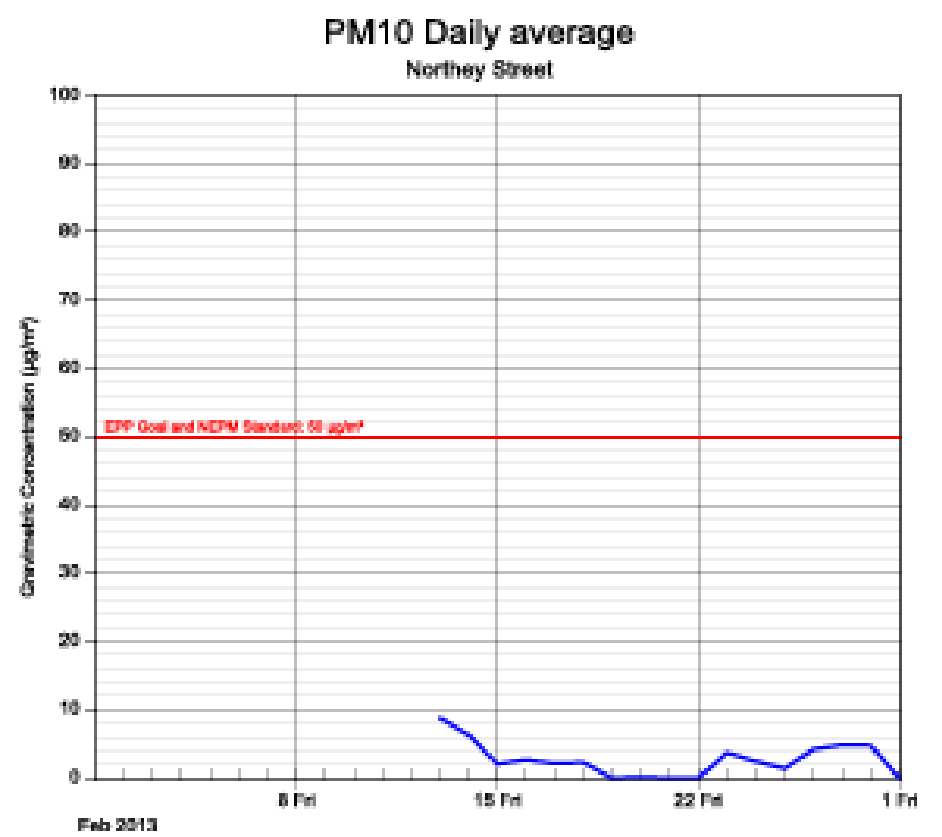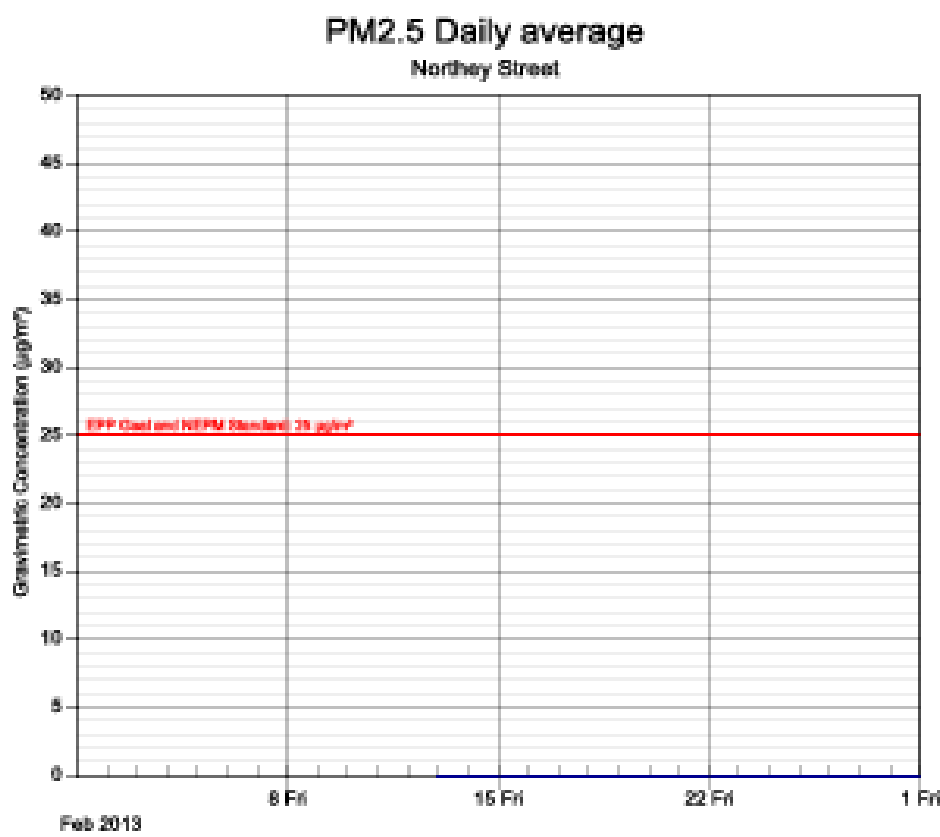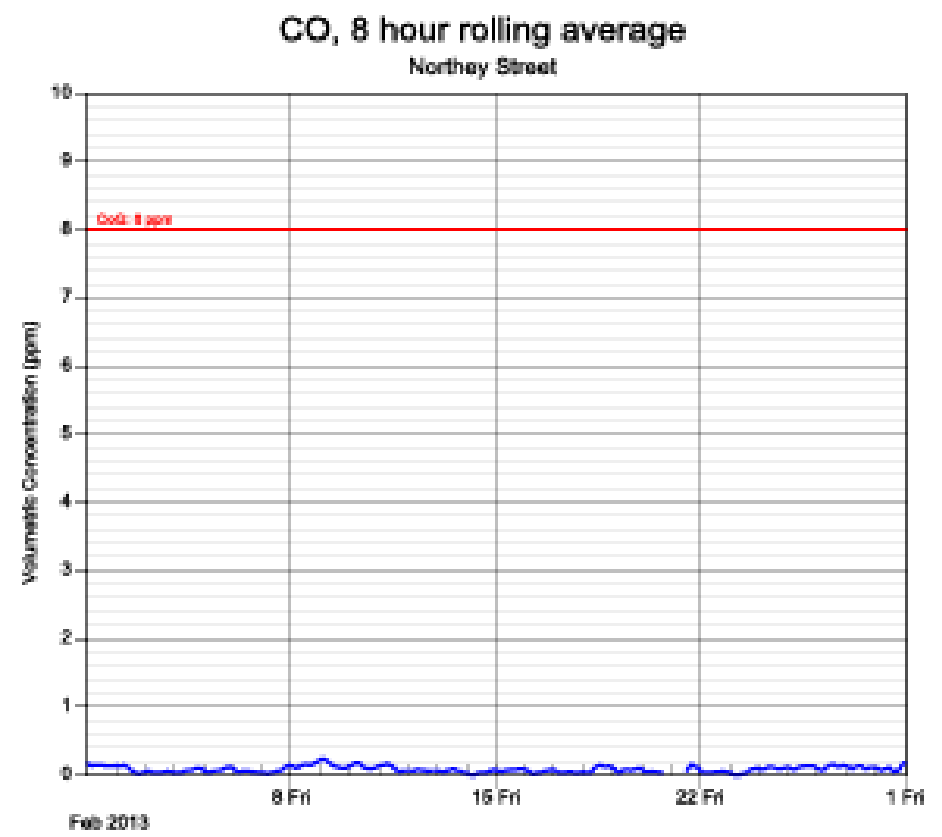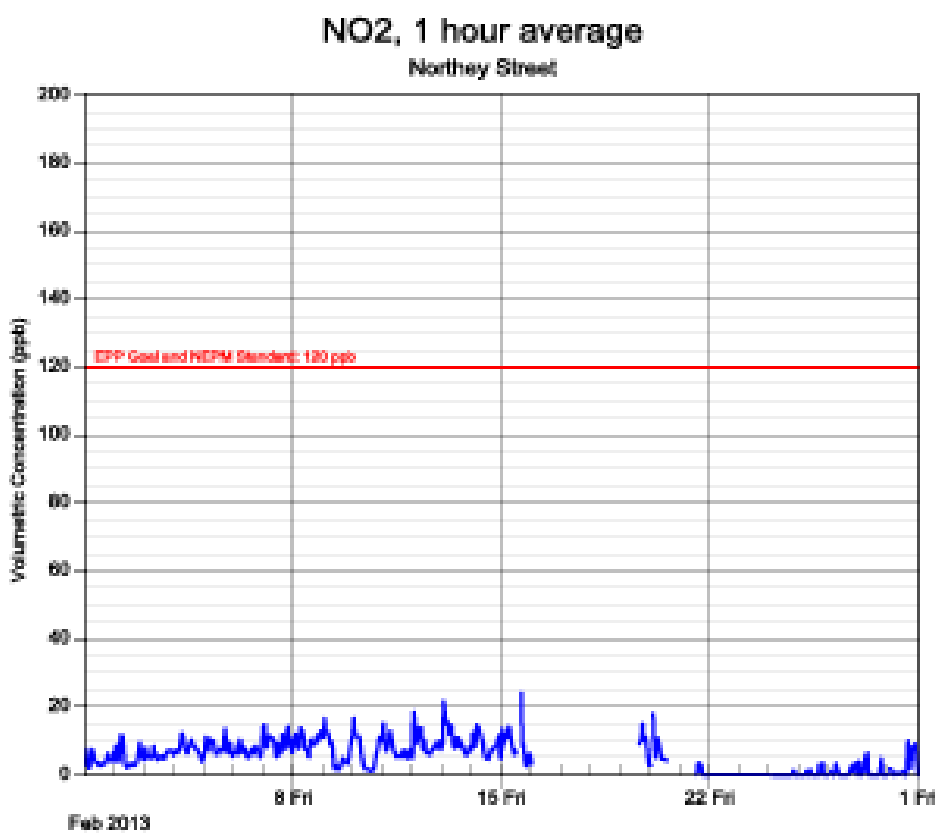


Exceedances: No exceedances for February 2013


4. Royal Brisbane Hospital (Northern High Level) – Maximum Values for February 2013

| Parameter | EPP Goal | Averaging Period | Maximum Value | Wind Direction | Date & Time |
|-------------------|----------------------|------------------|---------------|----------------|------------------|
| NO ₂ | 120 ppb | 1 hour | 19.6 ppb | 184° | 07/02/2013 07:00 |
| CO | 9 ppm | 8 hours | 0.3 ppm | 137° | 10/02/2013 00:00 |
| PM _{2.5} | 25 µg/m ³ | 24 hours | - | - | - |
| PM ₁₀ | 50 µg/m ³ | 24 hours | - | - | - |

NO₂, 1 hour average
Royal Brisbane Hospital

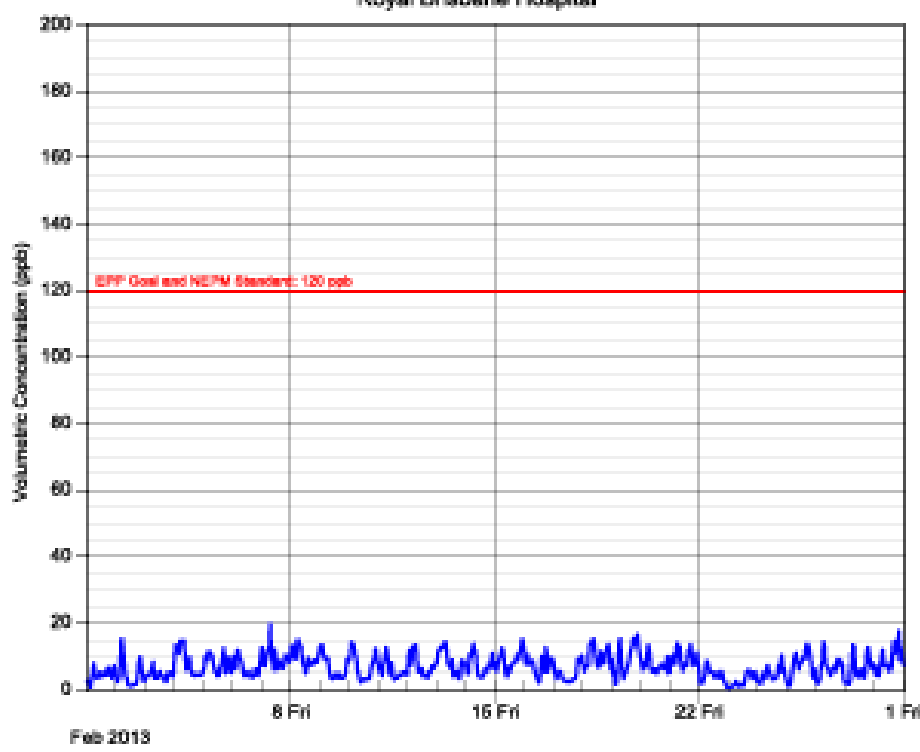

CO, 8 hour rolling average
Royal Brisbane Hospital

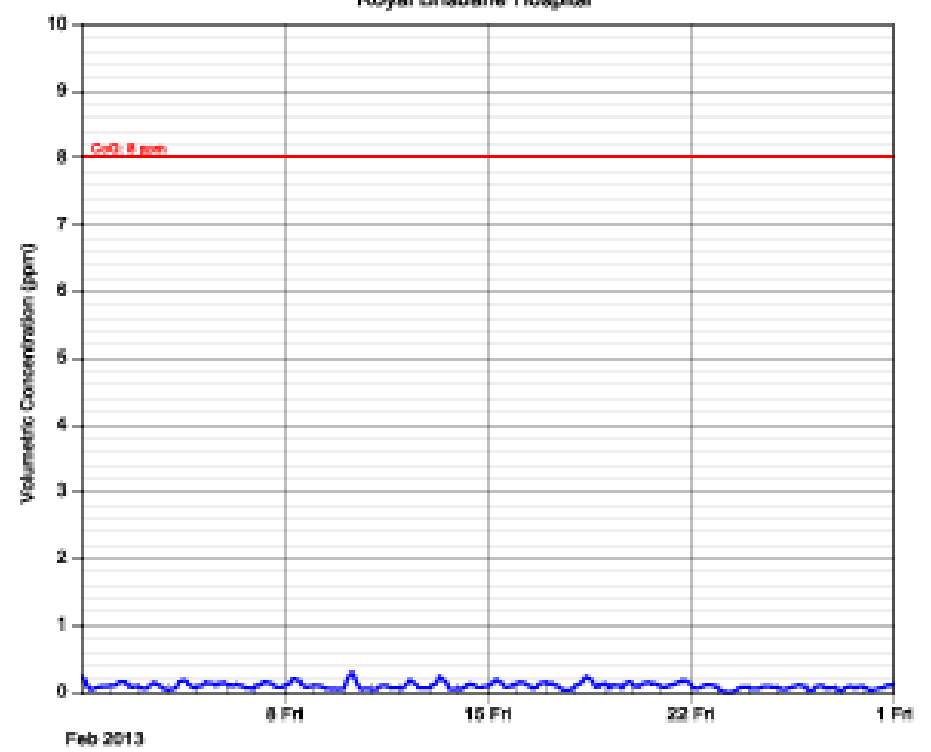

No valid data is available for PM_{2.5} during this reporting period.

No valid data is available for PM₁₀ during this reporting period.